

Filter-box FBS 25 (small)

Technical Documentation



Manufacturer:

SECURITON GmbH
Von-Drais-Straße 33
77855 Achern, Germany
www.securiton.de

The product (hardware, software and technical documentation) is subject to the copyright of the manufacturer. Any prohibited modification, misuse, copying or prohibited sale of this product represents a violation of the copyright and will be legally prosecuted.

Copyright by SECURITON GmbH

Validity



NOTICE

This document is valid only for the product described in this chapter and may be changed or withdrawn without prior notice. The validity of the statements made in this document applies until the statements are revised by a new edition of the document (TD 004 032 with new index). The user of this document is responsible for staying up to date with its current status through the editor/publisher. We accept no responsibility for claims against any incorrect statements in this document that were unknown to the publisher at the time of publication. Handwritten changes and additions are invalid.

Foreign language documents as listed in this document are always released or changed at the same time as the German edition. If there are inconsistencies between the foreign language document and the German document, the German text is binding.

Some words in this document are highlighted in blue. These terms and designations are the same in all languages and are not translated. Users are encouraged to contact the editor/publisher if there are statements which are unintelligible, misleading, incorrect or which contain errors.

This document is intended for trained specialists for mounting, installation, commissioning and maintenance of the product.



HINWEIS

This document is intended solely for guidance of customers, and, where applicable, their employees, on the state of affairs concerning its subject. Whilst every effort has been made to ensure its accuracy, readers should not rely upon its completeness or correctness, nor rely on it as legal interpretation. SECURITON will not be liable for the provision of any incorrect or incomplete information. Note: The German version of this document is the approved reference document.



HINWEIS

The product and all associated documents that correspond to a quality assurance process. We are heard to incorporate all changes promptly. Heard there can be changes come that are not yet closed. SECURITON GmbH buy themselves before the unannounced rights. This document contains the status at the time of going to press. The latest version of the documentation can be become right at first.



NOTICE

The following document is applicable to the filter-box FBS 25 (small) with the following production version:

Production version
from 10716

The validity of older production versions is guaranteed, with the exception of the new functionalities described in this edition. Additional information about the new functionalities can be found in the document history.

Document history

First edition **Date 01.02.2018**

Index "a" **Date 12/01/2012**

Most important changes compared with previous issue:

Chapter	New (n) / changed (c) / deleted (d)		What / Reason
6	c	Article numbers	Correction
7	c	Technical data	New format

Index "b" **Date 25/01/2013**

Most important changes compared with previous issue:

Chapter	New (n) / changed (c) / deleted (d)		What / Reason
6	c	Article numbers	Correction
9	n	List of figures	Addition
All	c	Documentation page format adjusted	New document format

Index "c" **Date 01/07/2016**

Most important changes compared with previous issue:

Chapter	New (n) / changed (c) / deleted (d)		What / Reason
•	c	Manufacturing status	Update
6	c	Article numbers	Correction

Index „d“ **Datum 01.07.2019**

Wichtigste Änderungen gegenüber Vorausgabe:

Kapitel	Neu (n) / geändert (c) / gelöscht (d)		Was / Grund
All	c	Order, names of headings	New template documentation
5	c	Update Fig.2 & Fig. 3	Supplement labeling, dimensioning
6	c	Update Fig.4	Supplement labeling, dimensioning
8	c	Article numbers	New document format

Index "e" **Date 06.08.2019**

Most important changes compared with previous issue:

Chapter	New (n) / changed (c) / deleted (d)		What / Reason
5	c	Update Fig.2	Correction position WCU 535
6.1	c	Update Fig.4	Correction spelling mistake

Index „f“ **Datum 01.05.2020**

Wichtigste Änderungen gegenüber Vorausgabe:

Kapitel	Neu (n) / geändert (c) / gelöscht (d)		Was / Grund
3	c	Construction	Update
4	c	Function	Update
5	c	Fig. 2 Standard-Installation for use in deep freeze area with the wiring connection unit WCU 535 PC	Adjustment of labeling of the componentsSecuri
5	c	Fig. 3 Installation without the wiring connection unit WCU 535 PC	Adjustment of labeling of the components
6.1	c	Fig. 4 Mounting orientation filter-box FBS 25 (small)	Adjustment of labeling of the components
7	c	Maintenance / Service	Update
8	c	Article numbers	ASD 53x, MV 25
9	c	Technical Data	Weight removed with packaging

Index "g" Date 01.11.2020**Most important changes compared with previous issue:**

Chapter	New (n) / changed (c) / deleted (d)		What / Reason
Validity	n	Notice on the validity of translations	Adaptation to GL product documentation
1.1	n	Intended Use	Adaptation to GL product documentation
8	c	Article numbers	Article number filter mat filter-box FBS 25 (VE=5)

Index "h" Date 30.03.2021**Most important changes compared with previous issue:**

Chapter	New (n) / changed (c) / deleted (d)		What / Reason
Validity	n	Notice field version	Addition
5	c	Fig. 2 Standard-Installation for use in deep freeze area with the wiring connection unit WCU 535 PC	Adjustment of labeling of the components
5	c	Fig. 3 Installation without the wiring connection unit WCU 535 PC	Adjustment of labeling of the components

Content

1	General	9
1.1	Intended Use	9
1.2	Safety and the environment	9
1.2.1	Notice and warning symbols	9
1.2.2	Safety information	10
1.2.3	Regulation EC No. 1907/2006 (REACH)	11
1.2.4	Disposal	11
1.3	Product identification	11
1.4	Guarantee	11
1.5	Product changes	11
2	Application area	12
3	Construction	13
4	Function	14
5	Mounting guidelines	15
6	Mounting / Commissioning	17
6.1	Mounting of the filter mat filter-box FBS 25 (small)	17
7	Maintenance / Service	18
8	Article numbers	19
9	Technical data	20
10	List of figures	21

1 General

1.1 Intended Use



Intended Use: Fire safety

NOTICE

1.2 Safety and the environment

Provided the product is deployed by trained and qualified personnel in accordance with this document, and provided the safety symbols all notices are observed, there is no danger to persons or property under normal conditions and when used properly. The product fulfils the requirements ensuring personal safety and environmental protection during operation. National and state-specific laws, regulations and directives must be observed and adhered to in all cases.

Observe these danger notices. They help prevent accidents and damage.

1.2.1 Notice and warning symbols

The following notice and warning symbols are used to draw attention to hazards and special properties.



DANGER

The product may represent an immediate danger with a high level of risk to persons if the notice is not duly observed. If the danger is not avoided, death or serious injury may result.



WARNING

The product may represent a possibly imminent danger with a medium level of risk to persons if the notice is not duly observed. If the danger is not avoided, death or serious injury may result.



CAUTION

The product may represent a possibly imminent danger with a low level of risk to persons if the notice is not duly observed. If the danger is not avoided, a minor injury may result.



NOTICE

If this notice is not observed, the product may malfunction, may cause property damage, or may be harmful to the environment.

1.2.2 Safety information



ELECTRICAL SHOCK

The product is operated with electrical current. In the event of incorrect mounting, installation, commissioning or maintenance, an electrical shock may be life-threatening or there is the danger of serious injury. It is imperative that the safety information is observed.



READ THE USER INSTRUCTIONS

To ensure safe and proper use, it is absolutely necessary to read the instructions and other documentation accompanying the product before use and to keep such documentation at hand for later reference. It is imperative that the danger information in particular is observed.



ELECTROSTATIC DISCHARGE

The product includes electronic components that are sensitive to electrostatic discharge (ESD). Contact with persons or objects can cause an electrostatic discharge that damages or destroys the product. ESD bands for preventing electrostatic discharge are used for grounding persons and for equipotential bonding.

1.2.3 Regulation EC No. 1907/2006 (REACH)



REGULATION EC NO. 1907/2006 (REACH)

General note: Declaration on the Regulation EC No. 1907/2006 on the Registration, Evaluation, Authorization and Restriction of Chemicals (REACH).

If the products contain substances from the candidate list in a concentration of >0.1% in accordance with Article 33 of Regulation (EC) No. 1907/2006 (REACH) and with regard to the associated safe handling, please visit the following website: <https://www.securiton.de/>.

1.2.4 Disposal



Electrical and electronic devices and batteries

It is not permitted to dispose of electrical and electronic devices or batteries in the domestic rubbish. As the end user you are legally obliged to return them. Used electrical and electronic devices as well as batteries can be returned to the seller or taken to a designated recycling centre (e.g. a community collection point or dealer) at no cost.



RECYCLING

The product and its components including their packaging consist of recyclable material and can be disposed of for recycling purposes as described in this document.

1.3 Product identification



NOTICE

The rating plates, type designations and/or identifications on devices and printed circuit boards must not be removed, written over or defaced in any way.

1.4 Guarantee



NOTICE

The product may be operated only with the hardware, software and commissioning media designated and delivered by the manufacturer. Any unauthorised intervention in the hardware and/or software or the use of non-system products is prohibited and may result in malfunctions and/or damage to the product. If this is not observed, all guarantee and warranty rights with respect to the manufacturer of the product will become null and void. Further, non-observance of the user instructions as well as improper maintenance and repair work void the guarantee and product liability.

1.5 Product changes



NOTICE

It is always recommended to use the latest version of the product software. A change to hardware or software of a product made by the manufacturer, is not a right to an update for existing products.

2 Application area

The filter-box small FBS 25 (small) is used as an accessory part for aspirating smoke detectors in areas with **low temperature conditions** (below 0°C) and high dust levels to prevent false alarms and to increase the lifespan of the smoke sensors substantially.

The filter insert is designed for the separation of particles and impurities. Due their particle size, smoke particles can pass through this filter unhindered. Reliable and fast fire detection is thus ensured.

3 Construction

The filter-box FBS 25 (small) is part of the sampling pipe. The housing is made of polycarbonate, colour RAL 7035. The filter box can be opened using the four cover screws in order to clean the filter mat small to change it.

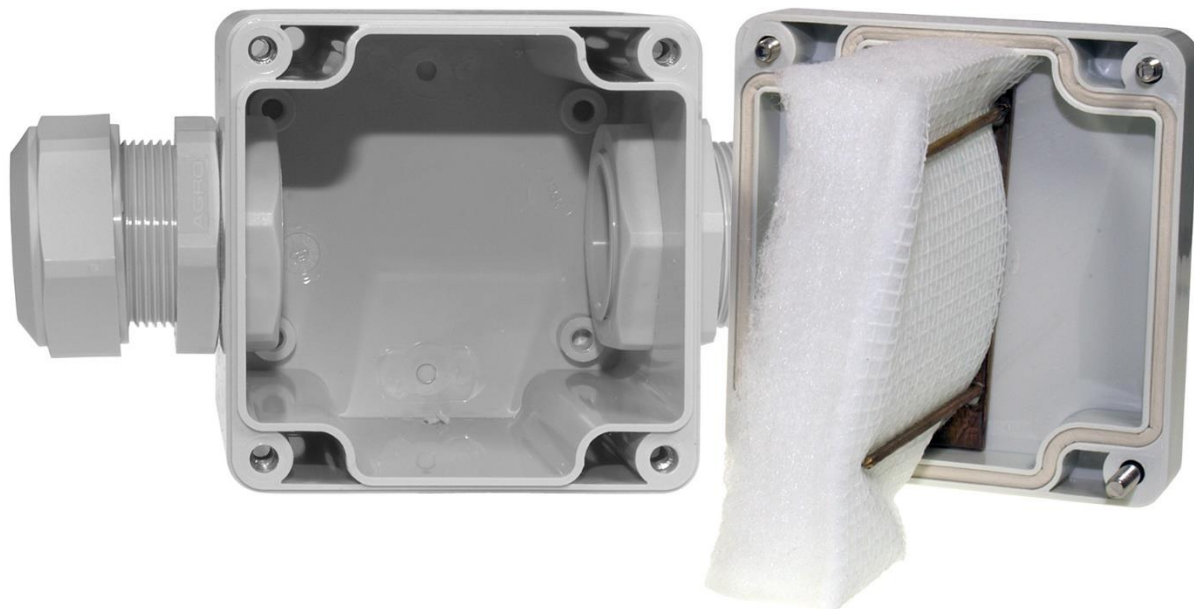


Fig. 1 Filter-box FBS 25 (small) open

4 Function

The air polluted with dust particles is also aspirated by the aspirating smoke detector. To prevent false alarms, the aspirated air must be purified of these particles. The filter-box FBS 25 (small) can be used for this purpose as an additional accessory component.

This is to be arranged directly in front of the evaluation unit in the sampling pipe (see Mounting guidelines). The aspirated air is conducted across the filter mat to filter the dust particles. If the filter mat is contaminated, it should be replaced during maintenance.

Advantages of the filter-box FBS 25 (small):

- Prevention or substantial reduction of false alarms
- Lengthening of lifespan of smoke sensors
- Very low installation costs
- Subsequent installation possible at any time
- Low operating costs
- Applicable for all aspirating smoke detectors
- Quick, clean and inexpensive solution
- **Field of application deep freeze area**

5 Mounting guidelines

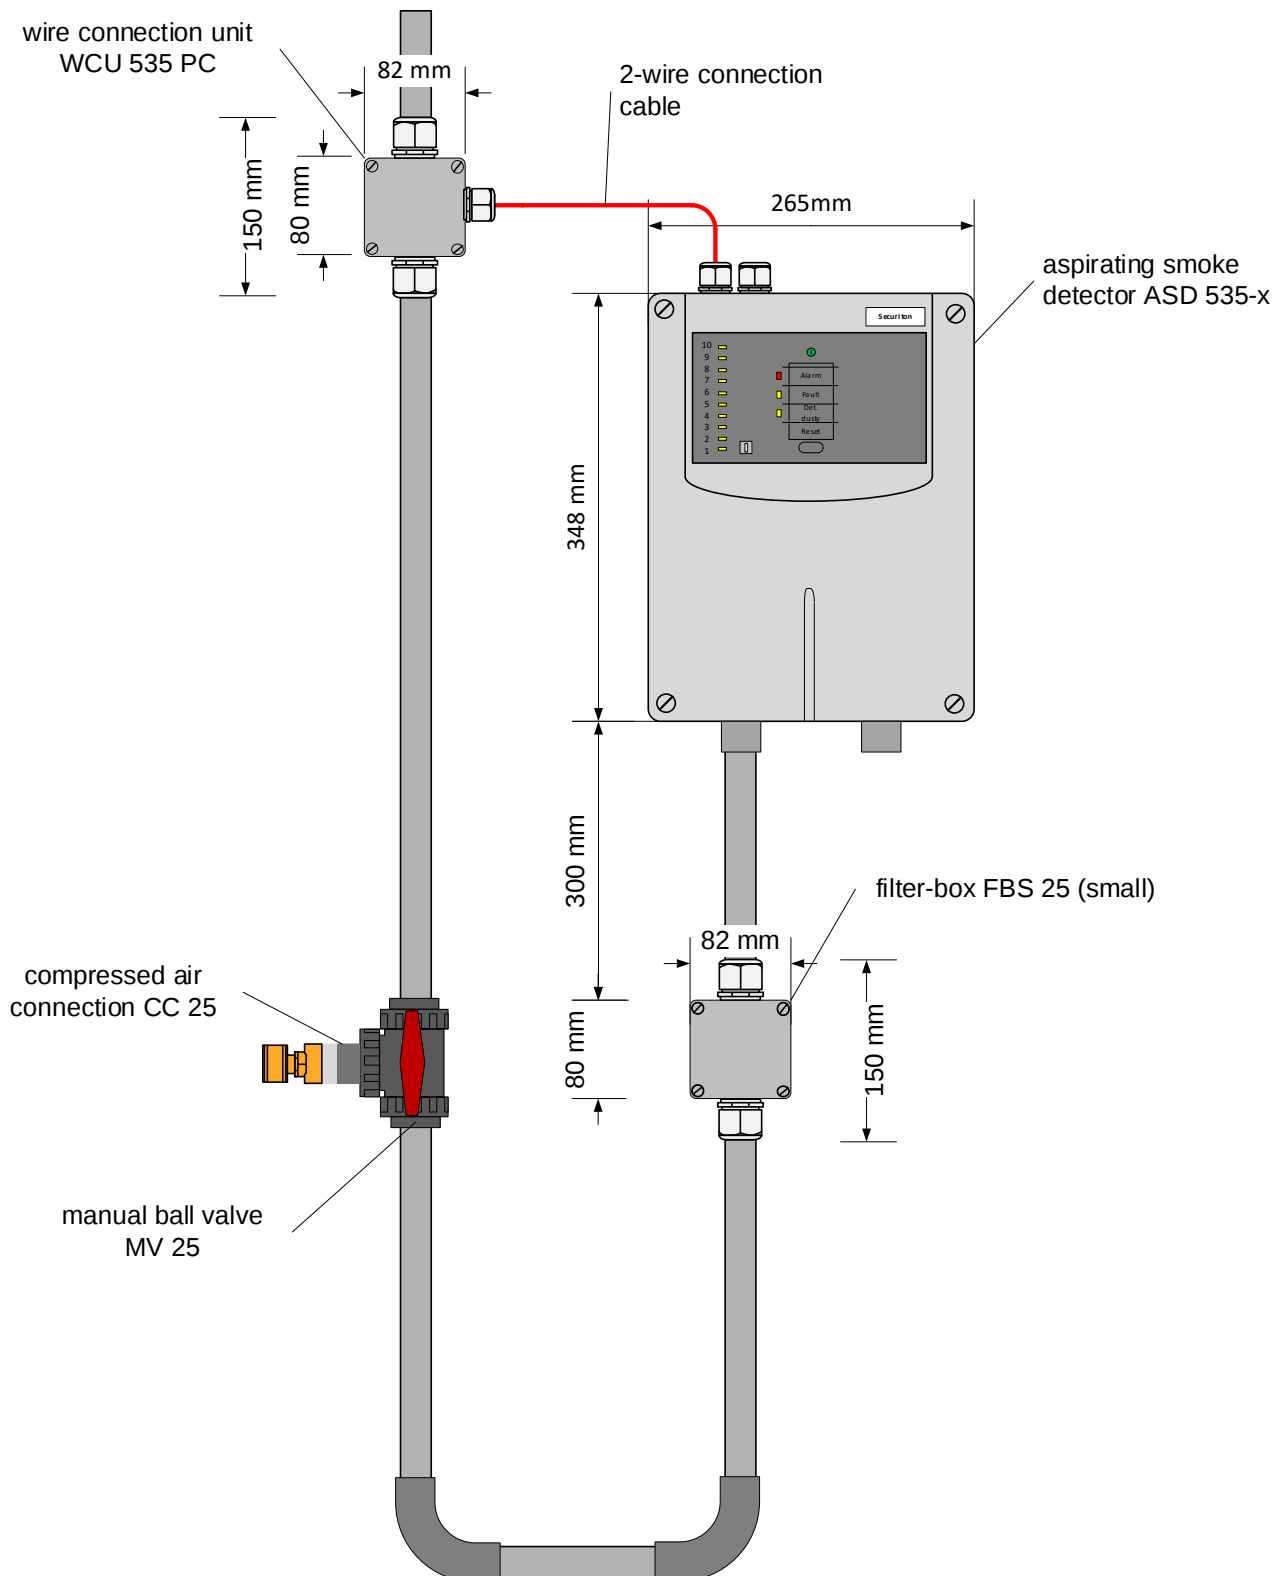


Fig. 2 Standard-Installation for use in deep freeze area with the wiring connection unit WCU 535 PC

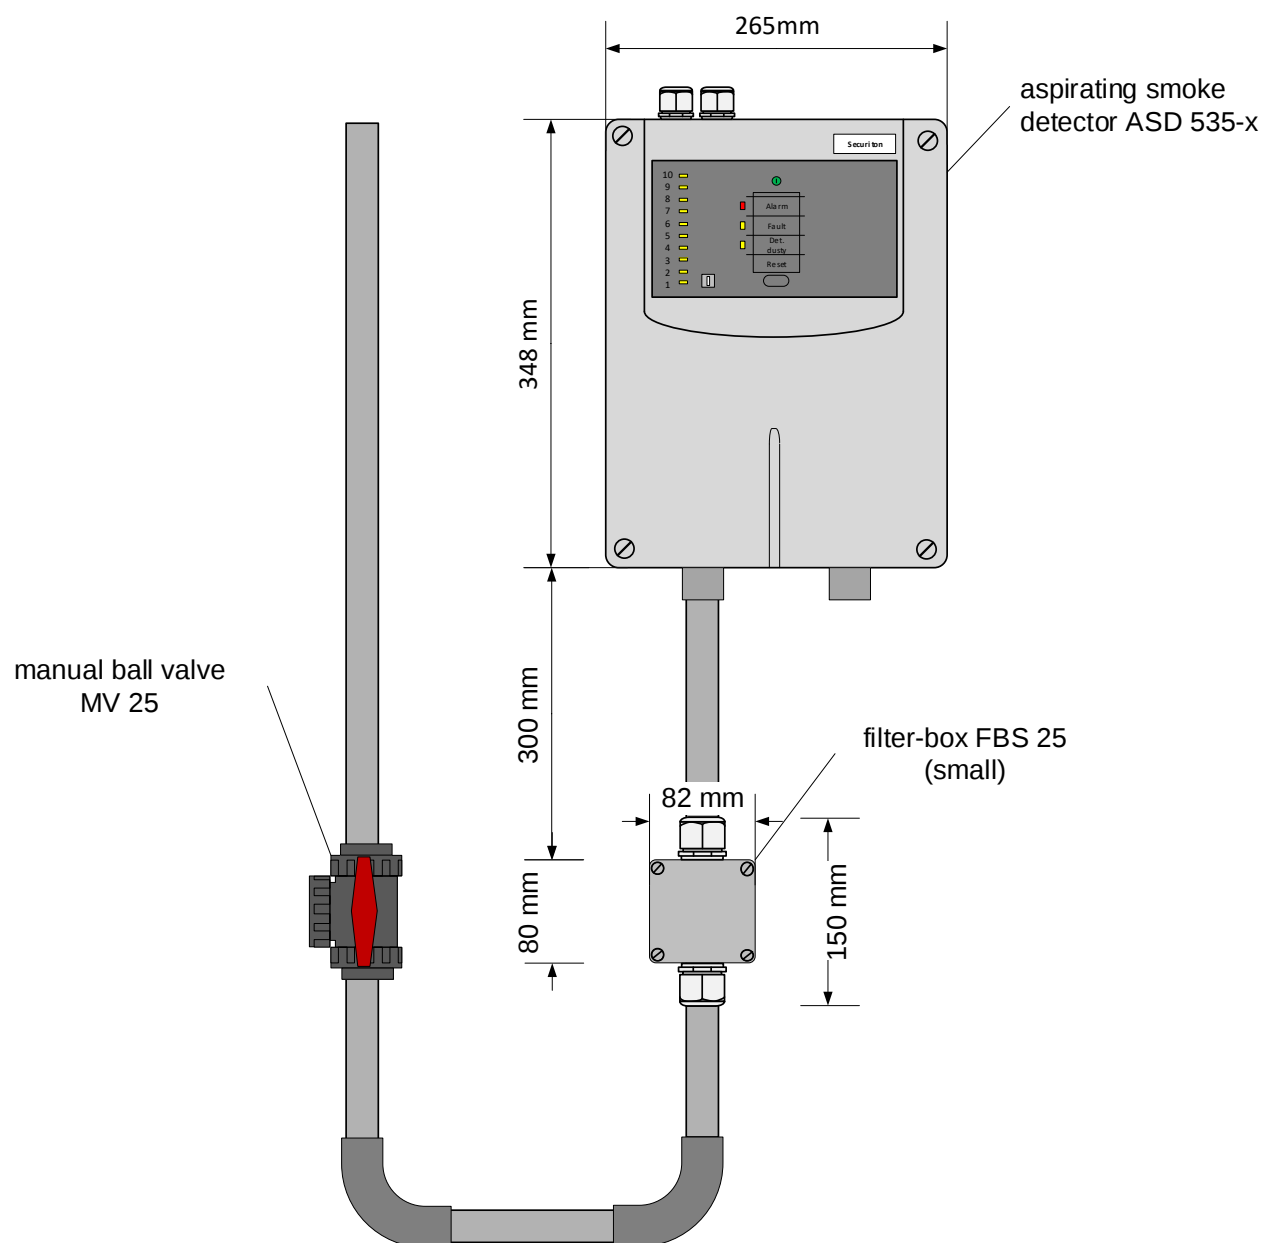


Fig. 3 Installation without the wiring connection unit WCU 535 PC

6 Mounting / Commissioning

The filter-box FBS 25 (small) must always be installed below the aspirating smoke detector to prevent false alarms due to falling dust particles. If the formation of ice (at temperatures up to -30°C) can be expected at the sampling holes, a wire connection unit WCU 535 should be installed in front of the filter box in accordance with the application guidelines for deep freeze stores (T131390). Assembly and arrangement should be carried out in accordance with the Mounting guidelines.

6.1 Mounting of the filter mat filter-box FBS 25 (small)

The Filter mat has to be placed with the mesh side to the ASD and the fleece side in direction of the sampling pipe.

to the aspirating smoke detector ASD 535-x

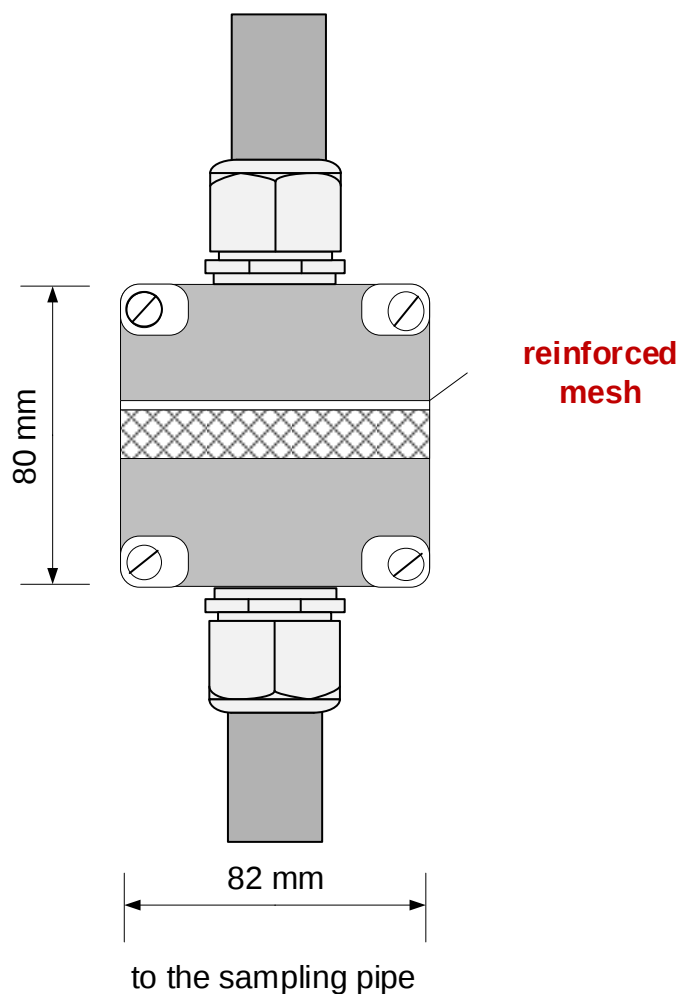


Fig. 4 Mounting orientation filter-box FBS 25 (small)

7 Maintenance / Service



NOTICE

Maintenance and service work on fire alarm systems are subject in part to country-specific laws and directives.

Maintenance and service work may be performed only by persons trained and authorised by the manufacturer of the aspirating smoke detector.

The technical documentation of the respective aspirating smoke detector must always be considered.



NOTICE

When carrying out maintenance work on the aspirating smoke detector, the filter mat should be replaced for the filter box FBS 25 (small), if necessary, and contamination within the filter box should be removed.

8 Article numbers

Abbreviated designation		Art. no. SECURITON
Aspirating smoke detector ASD 535-1	ASD 535-1	11-2000015-01-xx
Aspirating smoke detector ASD 535-2	ASD 535-2	11-2000016-01-xx
Aspirating smoke detector ASD 535-3	ASD 535-3	11-2000017-01-xx
Aspirating smoke detector ASD 535-3 HD	ASD 535-3 HD	11-2000036-01-xx
Aspirating smoke detector ASD 535-4	ASD 535-4	11-2000018-01-xx
Aspirating smoke detector ASD 535-4 HD	ASD 535-4 HD	11-2000037-01-xx
Smoke sensor SSD 535-1	SSD 535-1	11-2000008-01-xx
Smoke sensor SSD 535-1-CP	SSD 535-1-CP	11-2000011-01-xx
Smoke sensor SSD 535-2	SSD 535-2	11-2000009-01-xx
Smoke sensor SSD 535-2-CP	SSD 535-2-CP	11-2000012-01-xx
Smoke sensor SSD 535-3	SSD 535-3	11-2000010-01-xx
Smoke sensor SSD 535-3-CP	SSD 535-3-CP	11-2000013-01-xx
Filter-box FBS 25 (small)	FBS 25 PC	50-0500143-01-xx
Filter mat filter-box FBS 25 (VE=5)	FBS 25 EFM	50-0500112-02-xx
Wiring connection unit WCU 535 PC	WCU 535 PC	11-2300046-01-xx
Manual ball valve MV 25 PVC	MV 25 PVC	50-0500175-01-xx
Manual ball valve MV 25 PVC with safety lever	MV 25 PVC (SH)	11-2300081-01-xx
Manual ball valve MV 25 ABS	MV 25 ABS	50-0500174-01-xx
Manual ball valve MV 25 ABS with safety lever	MV 25 ABS (SH)	11-2300080-01-xx
Input/output module BX-OI3 (without housing)	BX-OI3	20-2100001-01-xx

9 Technical data

Features		
Environmental conditions		
Expanded environmental conditions:		
• Temperature range	-30 to +60	°C
Introduction	2x screw connections M32 incl. sealing	mm
Housing material	Polycarbonate (PC)	
Filtermat material	Polyester fiber	
Housing colour	Light grey 7035	RAL
Approval		
VdS	G208154	
Building product approval	0768-CPR-20600	
Dimensions (H x W x D)		
- without fittings:	80 x 82 x 85	mm
- with fittings:	150 x 82 x 85	mm
Weight	0,279	kg

10 List of figures

Fig. 1 Filter-box FBS 25 (small) open.....	13
Fig. 2 Standard-Installation for use in deep freeze area with the wiring connection unit WCU 535 PC	15
Fig. 3 Installation without the wiring connection unit WCU 535 PC	16
Fig. 4 Mounting orientation filter-box FBS 25 (small).....	17